



**ENERG**  
енергия · ενεργεια

Y IJA  
IE IA




Indoor unit E\*SD-\*\*\*\*D  
Outdoor unit PUD-SHWM60VAA(-BS)



55 °C

35 °C

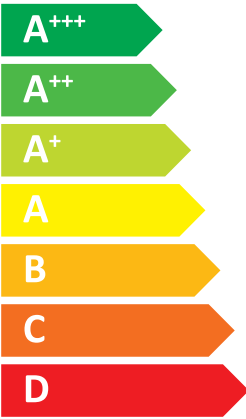

A++

A+++

**41** dB

**55** dB

■ 06	■ 06
■ <b>06</b>	■ <b>06</b>
■ 06	■ 06
kW	kW

2019

811/2013

BH79V004H05





Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	134	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	2.14	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	4.3	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	3.28	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	4.91	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.1	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	6.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.97	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	2.02	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items							
Capacity control		variable		Rated air flow rate, outdoors	-	2220	m <sup>3</sup> /h
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	3535	kWh				

For heat pump combination heater:							
Declared load profile		-		Water heating energy efficiency	$\eta_{wh}$	-	%
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	178	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	3.29	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	4.7	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	4.56	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	5.67	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.2	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	7.80	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.96	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	3.21	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items							
Capacity control		variable		Rated air flow rate, outdoors	-	2220	m <sup>3</sup> /h
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	2649	kWh				

For heat pump combination heater:							
Declared load profile		-		Water heating energy efficiency	$\eta_{wh}$	-	%
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).  
(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	113	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	3.6	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	2.52	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	3.5	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	3.27	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	4.3	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	4.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.1	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	6.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.97	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	1.44	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	5.2	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	1.44	-
Bivalent temperature	T <sub>biv</sub>	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items				Rated air flow rate, outdoors			
Capacity control		variable		-	2220	m <sup>3</sup> /h	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	4776	kWh				

For heat pump combination heater:				Water heating energy efficiency			
Declared load profile		-		$\eta_{wh}$	-	%	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.



Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	138	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	3.6	kW	Tj = - 7 °C	COPd	3.21	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 2 °C	Pdh	3.8	kW	Tj = + 2 °C	COPd	4.04	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = + 7 °C	Pdh	4.5	kW	Tj = + 7 °C	COPd	5.42	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = +12 °C	Pdh	3.1	kW	Tj = +12 °C	COPd	7.56	-
Degradation co-efficient (**)	Cdh	0.96	-				
Tj = bivalent temperature	Pdh	5.1	kW	Tj = bivalent temperature	COPd	2.22	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	5.2	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	2.29	-
Bivalent temperature	Tbiv	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	3903	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	159	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	-	kW	Tj = - 7 °C	COPd	-	-
Degradation co-efficient (**)	Cdh	-	-				
Tj = + 2 °C	Pdh	6.0	kW	Tj = + 2 °C	COPd	1.91	-
Degradation co-efficient (**)	Cdh	1.00	-				
Tj = + 7 °C	Pdh	3.9	kW	Tj = + 7 °C	COPd	3.28	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = +12 °C	Pdh	4.5	kW	Tj = +12 °C	COPd	6.16	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = bivalent temperature	Pdh	6.0	kW	Tj = bivalent temperature	COPd	1.91	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	-	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	-	-
Bivalent temperature	Tbiv	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW	Type of energy input	Electrical		
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1919	kWh
Rated air flow rate, outdoors			
		2220	m <sup>3</sup> /h

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
	$\eta_{wh}$	-	%

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.



Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	220	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	-	kW	Tj = - 7 °C	COPd	-	-
Degradation co-efficient (**)	Cdh	-	-				
Tj = + 2 °C	Pdh	6.0	kW	Tj = + 2 °C	COPd	3.80	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 7 °C	Pdh	4.4	kW	Tj = + 7 °C	COPd	4.89	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = +12 °C	Pdh	4.7	kW	Tj = +12 °C	COPd	7.46	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = bivalent temperature	Pdh	6.0	kW	Tj = bivalent temperature	COPd	3.80	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	-	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	-	-
Bivalent temperature	Tbiv	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1385	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	134	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	5.3	kW	Tj = - 7 °C	COPd	2.14	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 2 °C	Pdh	4.3	kW	Tj = + 2 °C	COPd	3.28	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 7 °C	Pdh	5.3	kW	Tj = + 7 °C	COPd	4.91	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = +12 °C	Pdh	3.1	kW	Tj = +12 °C	COPd	6.89	-
Degradation co-efficient (**)	Cdh	0.97	-				
Tj = bivalent temperature	Pdh	6.0	kW	Tj = bivalent temperature	COPd	2.02	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	-	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	-	-
Bivalent temperature	Tbiv	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW	Type of energy input	Electrical		
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	3535	kWh
Rated air flow rate, outdoors			
		2220	m <sup>3</sup> /h

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
	$\eta_{wh}$	-	%

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	178	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	3.29	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	4.7	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	4.56	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	5.67	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.2	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	7.80	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.96	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	3.21	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW	Type of energy input	Electrical		
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	2649	kWh
Rated air flow rate, outdoors			
		2220	m <sup>3</sup> /h

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
	$\eta_{wh}$	-	%

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	113	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	3.6	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	2.52	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	3.5	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	3.27	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	4.3	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	4.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.1	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	6.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.97	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	1.44	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	5.2	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	1.44	-
Bivalent temperature	T <sub>biv</sub>	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items				Rated air flow rate, outdoors			
Capacity control		variable		-	2220	m <sup>3</sup> /h	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	4776	kWh				

For heat pump combination heater:				Water heating energy efficiency			
Declared load profile		-		$\eta_{wh}$	-	%	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	138	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	3.6	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	3.21	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	3.8	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	4.04	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	4.5	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	5.42	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.1	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	7.56	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.96	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	2.22	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	5.2	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	2.29	-
Bivalent temperature	T <sub>biv</sub>	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items				Rated air flow rate, outdoors			
Capacity control		variable		-	2220	m <sup>3</sup> /h	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	3903	kWh				

For heat pump combination heater:				Water heating energy efficiency			
Declared load profile		-		$\eta_{wh}$	-	%	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	159	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	-	kW	Tj = - 7 °C	COPd	-	-
Degradation co-efficient (**)	Cdh	-	-				
Tj = + 2 °C	Pdh	6.0	kW	Tj = + 2 °C	COPd	1.91	-
Degradation co-efficient (**)	Cdh	1.00	-				
Tj = + 7 °C	Pdh	3.9	kW	Tj = + 7 °C	COPd	3.28	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = +12 °C	Pdh	4.5	kW	Tj = +12 °C	COPd	6.16	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = bivalent temperature	Pdh	6.0	kW	Tj = bivalent temperature	COPd	1.91	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	-	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	-	-
Bivalent temperature	Tbiv	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1919	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	EHSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	220	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	-	kW	Tj = - 7 °C	COPd	-	-
Degradation co-efficient (**)	Cdh	-	-				
Tj = + 2 °C	Pdh	6.0	kW	Tj = + 2 °C	COPd	3.80	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 7 °C	Pdh	4.4	kW	Tj = + 7 °C	COPd	4.89	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = +12 °C	Pdh	4.7	kW	Tj = +12 °C	COPd	7.46	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = bivalent temperature	Pdh	6.0	kW	Tj = bivalent temperature	COPd	3.80	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	-	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	-	-
Bivalent temperature	Tbiv	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW	Type of energy input	Electrical		
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1385	kWh
Rated air flow rate, outdoors			
		2220	m <sup>3</sup> /h

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
	$\eta_{wh}$	-	%

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.



Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	134	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	2.14	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	4.3	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	3.28	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	4.91	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.1	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	6.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.97	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	2.02	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items				Rated air flow rate, outdoors			
Capacity control	variable			-	2220	m <sup>3</sup> /h	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	3535	kWh				

For heat pump combination heater:				Water heating energy efficiency			
Declared load profile	-			$\eta_{wh}$	-	%	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	178	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	3.29	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	4.7	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	4.56	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	5.67	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.2	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	7.80	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.96	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	3.21	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	2649	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	113	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	3.6	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	2.52	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	3.5	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	3.27	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	4.3	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	4.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.1	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	6.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.97	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	1.44	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	5.2	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	1.44	-
Bivalent temperature	T <sub>biv</sub>	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items				Rated air flow rate, outdoors	-	2220	m <sup>3</sup> /h
Capacity control	variable						
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	4776	kWh				

For heat pump combination heater:				Water heating energy efficiency	$\eta_{wh}$	-	%
Declared load profile	-						
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).  
(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	138	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	3.6	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	3.21	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	3.8	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	4.04	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	4.5	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	5.42	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.1	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	7.56	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.96	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	2.22	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	5.2	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	2.29	-
Bivalent temperature	T <sub>biv</sub>	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items				Rated air flow rate, outdoors	-	2220	m <sup>3</sup> /h
Capacity control	variable						
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)				
Annual energy consumption	Q <sub>HE</sub>	3903	kWh				

For heat pump combination heater:				Water heating energy efficiency	$\eta_{wh}$	-	%
Declared load profile	-						
Daily electricity consumption	Q <sub>elec</sub>	-	kWh				
Annual electricity consumption	AEC	-	kWh				

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	159	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	-	-
Degradation co-efficient (**)	C <sub>dh</sub>	-	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	1.91	-
Degradation co-efficient (**)	C <sub>dh</sub>	1.00	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	3.9	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	3.28	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	4.5	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	6.16	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	1.91	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1919	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-****D
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		yes
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	220	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	-	kW	Tj = - 7 °C	COPd	-	-
Degradation co-efficient (**)	Cdh	-	-				
Tj = + 2 °C	Pdh	6.0	kW	Tj = + 2 °C	COPd	3.80	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 7 °C	Pdh	4.4	kW	Tj = + 7 °C	COPd	4.89	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = +12 °C	Pdh	4.7	kW	Tj = +12 °C	COPd	7.46	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = bivalent temperature	Pdh	6.0	kW	Tj = bivalent temperature	COPd	3.80	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	-	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	-	-
Bivalent temperature	Tbiv	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1385	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	134	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	5.3	kW	Tj = - 7 °C	COPd	2.14	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 2 °C	Pdh	4.3	kW	Tj = + 2 °C	COPd	3.28	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 7 °C	Pdh	5.3	kW	Tj = + 7 °C	COPd	4.91	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = +12 °C	Pdh	3.1	kW	Tj = +12 °C	COPd	6.89	-
Degradation co-efficient (**)	Cdh	0.97	-				
Tj = bivalent temperature	Pdh	6.0	kW	Tj = bivalent temperature	COPd	2.02	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	-	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	-	-
Bivalent temperature	Tbiv	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	3535	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.



Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		average climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	178	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	5.3	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	3.29	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	4.7	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	4.56	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	5.1	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	5.67	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	3.2	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	7.80	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.96	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	3.21	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	-10	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	-10	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	2649	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	113	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	3.6	kW	Tj = - 7 °C	COPd	2.52	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 2 °C	Pdh	3.5	kW	Tj = + 2 °C	COPd	3.27	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 7 °C	Pdh	4.3	kW	Tj = + 7 °C	COPd	4.89	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = +12 °C	Pdh	3.1	kW	Tj = +12 °C	COPd	6.89	-
Degradation co-efficient (**)	Cdh	0.97	-				
Tj = bivalent temperature	Pdh	5.1	kW	Tj = bivalent temperature	COPd	1.44	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	5.2	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	1.44	-
Bivalent temperature	Tbiv	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	4776	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		colder climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	138	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = - 7 °C	Pdh	3.6	kW	Tj = - 7 °C	COPd	3.21	-
Degradation co-efficient (**)	Cdh	0.99	-				
Tj = + 2 °C	Pdh	3.8	kW	Tj = + 2 °C	COPd	4.04	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = + 7 °C	Pdh	4.5	kW	Tj = + 7 °C	COPd	5.42	-
Degradation co-efficient (**)	Cdh	0.98	-				
Tj = +12 °C	Pdh	3.1	kW	Tj = +12 °C	COPd	7.56	-
Degradation co-efficient (**)	Cdh	0.96	-				
Tj = bivalent temperature	Pdh	5.1	kW	Tj = bivalent temperature	COPd	2.22	-
Tj = operation limit temperature	Pdh	4.4	kW	Tj = operation limit temperature	COPd	1.42	-
Tj = - 15 °C (if TOL < - 20 °C)	Pdh	5.2	kW	Tj = - 15 °C (if TOL < - 20 °C)	COPd	2.29	-
Bivalent temperature	Tbiv	-16	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	Tdesignh	-22	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	1.3	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW				
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				
				Type of energy input	Electrical		

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	3903	kWh
Rated air flow rate, outdoors			
-			
2220			
m <sup>3</sup> /h			

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
$\eta_{wh}$			
-			
%			

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		medium-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	159	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	-	-
Degradation co-efficient (**)	C <sub>dh</sub>	-	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	1.91	-
Degradation co-efficient (**)	C <sub>dh</sub>	1.00	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	3.9	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	3.28	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	4.5	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	6.16	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	1.91	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW	Type of energy input	Electrical		
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1919	kWh
Rated air flow rate, outdoors			
		2220	m <sup>3</sup> /h

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
	$\eta_{wh}$	-	%

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.

Model(s):	Outdoor unit:	PUD-SHWM60VAA(-BS)
	Indoor unit:	ERSD-MED
Air-to-water heat pump:		yes
Water-to-water heat pump:		no
Brine-to-water heat pump:		no
Low-temperature heat pump:		no
Equipped with a supplementary heater:		no
Heat pump combination heater:		no
Parameters for		low-temperature application.
Parameters for		warmer climate conditions.

Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Rated heat output (*)	Prated	6.0	kW	Seasonal space heating energy efficiency	$\eta_s$	220	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>				Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature T <sub>j</sub>			
T <sub>j</sub> = - 7 °C	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 7 °C	COP <sub>d</sub>	-	-
Degradation co-efficient (**)	C <sub>dh</sub>	-	-				
T <sub>j</sub> = + 2 °C	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = + 2 °C	COP <sub>d</sub>	3.80	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.99	-				
T <sub>j</sub> = + 7 °C	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = + 7 °C	COP <sub>d</sub>	4.89	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = +12 °C	P <sub>dh</sub>	4.7	kW	T <sub>j</sub> = +12 °C	COP <sub>d</sub>	7.46	-
Degradation co-efficient (**)	C <sub>dh</sub>	0.98	-				
T <sub>j</sub> = bivalent temperature	P <sub>dh</sub>	6.0	kW	T <sub>j</sub> = bivalent temperature	COP <sub>d</sub>	3.80	-
T <sub>j</sub> = operation limit temperature	P <sub>dh</sub>	4.4	kW	T <sub>j</sub> = operation limit temperature	COP <sub>d</sub>	1.42	-
T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	P <sub>dh</sub>	-	kW	T <sub>j</sub> = - 15 °C (if TOL < - 20 °C)	COP <sub>d</sub>	-	-
Bivalent temperature	T <sub>biv</sub>	2	°C	Operation limit temperature	TOL	-28	°C
Reference design conditions for space heating	T <sub>designh</sub>	2	°C	Heating water operating limit temperature	WTOL	60	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P <sub>OFF</sub>	0.015	kW	Rated heat output (*)	P <sub>sup</sub>	0.0	kW
Thermostat-off mode	P <sub>TO</sub>	0.015	kW	Type of energy input	Electrical		
Standby mode	P <sub>SB</sub>	0.015	kW				
Crankcase heater mode	P <sub>CK</sub>	0.000	kW				

Other items			
Capacity control		variable	
Sound power level, indoors/outdoors	L <sub>WA</sub>	41 / 55	dB(A)
Annual energy consumption	Q <sub>HE</sub>	1385	kWh
Rated air flow rate, outdoors			
		-	2220 m <sup>3</sup> /h

For heat pump combination heater:			
Declared load profile		-	
Daily electricity consumption	Q <sub>elec</sub>	-	kWh
Annual electricity consumption	AEC	-	kWh
Water heating energy efficiency			
	$\eta_{wh}$	-	%

Contact details  
MITSUBISHI ELECTRIC AIR CODITIONING SYSTEM EUROPE LTD. Nettlehill Road, Houston Industrial Estate, Livingston, EH54 5EQ, Scotland, U.K.

(\*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater Psup is equal to the supplementary capacity for heating sup(Tj).

(\*\*) If Cdh is not determined by measurement then the default degradation coefficient is Cdh = 0,9.